


## GENERAL NOTES

1. DO NOT SCALE THE DRAWINGS. USE INDICATED DIMENSIONS ONLY.


- 2. ALL WORK SHALL CONFORM TO LOCAL AND NEW YORK STATE CODE REQUIREMENTS. NO WORK SHALL COMMENCE UNTIL A BUILDING PERMIT HAS BEEN ISSUED AS REQUIRED BY THE LOCAL BUILDING DEPARTMENT.
- 3. ALL DIMENSIONS ARE TO FACE OF STUD UNLESS OTHERWISE INDICATED. DOOR SIZES ARE IN FEET-INCHES. REFER TO THE INTERIOR ELEVATIONS FOR DOOR HEIGHT AND STYLE.
- 4. ALL NEW WALL BASE PLATES SHALL BE SET IN A MINIMUM  $\frac{3}{6}$ " CONTINUOUS BEAD OF CAULK OR SEALANT. ALL PENETRATIONS THROUGH CEILINGS AND EXTERIOR WALLS SHALL BE AIR SEALED WITH EXPANDING FOAM AND/OR SILICONE CAULK PRIOR TO FLASHING.
- 5. ALL NEW EXTERIOR WALLS ARE 2x6 STUDS AT 16"OC UNLESS OTHERWISE NOTED. ALL INTERIOR WALLS ARE 2x4 STUDS AT 16"OC UNLESS OTHERWISE INDICATED.
- 6. DOUBLE UP JOISTS UNDER PARALLEL PARTITIONS.
- WINDOWS ARE 400 SERIES BY ANDERSEN. UNITS TO BE LOW-E COATED WITH INSULATING GLASS AND ARGON GAS. PROVIDE ALL OPERATING UNITS WITH SCREENS. UNIT NUMBERS ARE INDICATED ON THE PLANS.
- 8. ALL WOOD IN CONTACT WITH MASONRY & CONCRETE SHALL BE PRESSURE TREATED WITH A WOOD PRESERVATIVE.
- 9. INSTALL HANGERS AND CONNECTORS BY SIMPSON STRONG-TIE (SST) AS NOTED ON THE DRAWINGS AND DETAILS. INSTALL ALL CONNECTORS WITH NAILS OR SCREWS AS SPECIFIED BY SIMPSON STRONG-TIE. DO NOT SUBSTITUTE CONNECTORS OR FASTENERS. ALL FASTENER COATINGS SHALL MATCH THE EXTERIOR COATING OF THE SPECIFIED HANGER: HDG TO HDG AND STAINLESS TO STAINLESS.
- 10. FLASH ALL WINDOW ROUGH OPENINGS WITH A PEEL & STICK TYPE MEMBRANE FLASHING. FLASH SILLS TO CREATE A DRAIN PAN PITCHED TO THE EXTERIOR SIDE.
- 11. INSTALL BOISE 'VERSA-LAM' 2.0 3100fb LAMINATED STRUCTURAL LUMBER BEAMS IN SOLID WIDTHS AS INDICATED ON THE DRAWINGS. DO NOT NOTCH BEAMS. PROVIDE MINIMUM 3" SOLID BEARING AT ENDS UNLESS OTHERWISE INDICATED.
- 12. SEAL AROUND ALL DOOR AND WINDOW ROUGH OPENINGS WITH MINIMALLY EXPANDING FOAM. FOLLOW MANUFACTURERS PRECAUTIONS.
- 13. ANY EXISTING EXTERIOR WALL CAVITY THAT IS OPENED SHALL BE FILLED TO THE FULL DEPTH OF THE CAVITY WITH HIGH DENSITY FIBERGLASS INSULATION. TYPICAL.
- 14. REFER TO THE SPECIFICATIONS FOR ADDITIONAL INFORMATION.

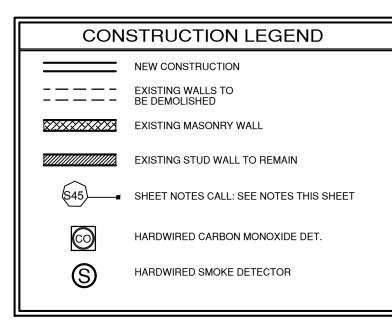

## **BOWEN ADDITION**

114 OLD MOUNTAIN RD. UPPER NYACK, N.Y. 10960





SCALE AS SHOWN DATE FEBRUARY 17, 2020 JOB NO. 1909 **REVISIONS:** 

